




CHULA VISTA FIRE DEPARTMENT

FIRE PREVENTION DIVISION


Multi-Family Sprinkler Connection (FDC*) Detail

*FDC's located on the building must have prior approval from the Fire Marshal.

Detail A - Sign Only

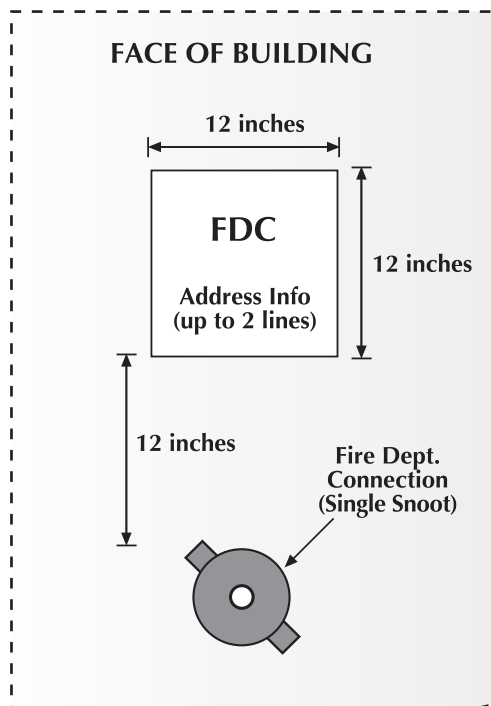

Detail B - Sign and Building

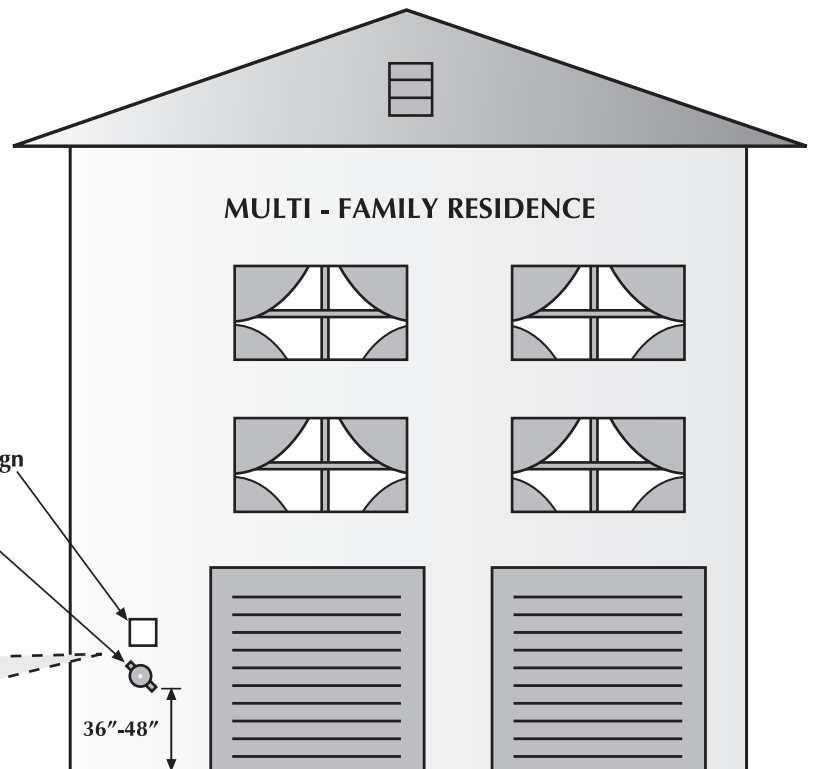

Sign Specifications

1. Measurements MUST be exact and will be subject to a field inspection.
2. Sign must be .080 gauge aluminum.
3. Sign must be TYPE IV high intensity prismatic sheeting [H.I.P.]
4. Protective overlay film on sign [P.O.F].
5. Signage letter height:
 - FDC = 3 inches tall and Address = 1 1/4 inches tall
6. White background with black lettering
7. Sign must be permanently attached to the building (12 inches) above the FDC.
8. Hole and radii to conform with the State of California specifications.

